


## Guidelines for Metering Cabinets

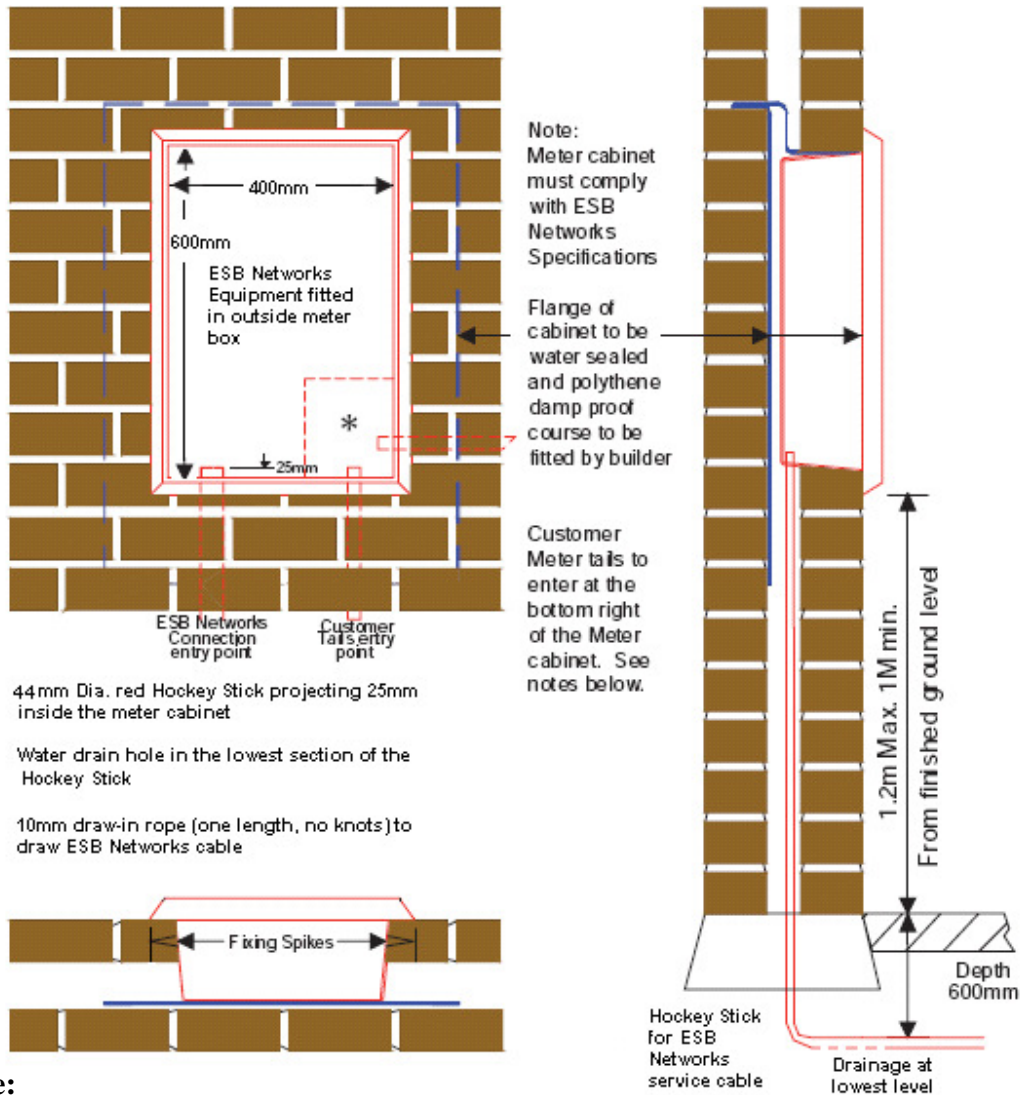

**Note:**

- To comfortably facilitate the installation of this unit, builders should provide an opening of (h)606mm, (w) 403mm, (d) 155mm
- The meter cabinet must be directly accessible from the main entrance driveway. A position on the house wall facing the driveway, or within 2m of either corner of this wall is normally acceptable subject to proper access.
- Each outside box must have identification to associate it with a particular installation/address, this I.D. should be in place at service installation stage.
- This is a Guideline and should be used as a reference only. Please refer to Page 1 of the National Code of Practice for more detailed requirements. This can be accessed via the ESB website, [www.esb.ie](http://www.esb.ie), or via the following link [http://www.esb.ie/esbnetworks/downloads/national\\_code\\_of\\_practice.pdf](http://www.esb.ie/esbnetworks/downloads/national_code_of_practice.pdf)